

# **Firefly User's Manual for the "OASIS"**

**G31M**

**2025**

**Firefly International Energy Co.**

Office : 155 L New Boston Street, Woburn, MA 01801, USA.

[WWW.FIREFLYENERGY.COM](http://WWW.FIREFLYENERGY.COM)

## **Congratulations on your purchase of a Firefly Oasis Battery!**

The Firefly batteries use a patented carbon Microcell Foam grid structure that is highly resistant to sulfation and grid corrosion. They have the longest life compare to any of lead acid battery used for deep cycling, even at extreme temperatures and operation at less than full charge.

### **The Firefly batteries have many advantages over a traditional lead acid battery:**

- Plate corrosion is inhibited.
- Plates are resistant to hard sulfation.
- The high plate porosity allows the electrolyte to react more efficiently.

### **Receiving & Refreshing Charge**

- Check the Individual battery voltages, it will be around 12.90 V for a fully charged 12VG31M Battery.
- Freshening charge shall be carried out using a CCCV (Constant current \_Constant voltage charger as per OCV voltage observed on the batteries.
- In case the OCV (Open circuit voltage) of the battery is less than 12.70 V, the G31M battery needs to be charged @ 14.40 V (2.40 V / cell) for 12 hrs. before commissioning.

## **INSTALLATION**

### **MOUNTING ORIENTATION**

- The G31M should be installed upright or on its length side only.

### **SPACE AND VENTILATION**


- The batteries should be installed with a minimum of 0.6 inch (1.52 cm) between batteries to allow for proper ventilation and air circulation. If space allows, 1 inch (2.54cm) between batteries is recommended for ideal operation.
- There also needs to be adequate space in the compartment for ventilation.
- If possible, mount the batteries on low stand-offs to encourage air circulation around their bases.

### **FOLLOW ALL ABYC INSTALLATION GUIDELINES**

- The batteries should be fastened securely and restrained from movement in any direction.
- The positive terminals should be protected by a cover or boots.
- Refer to ABYC standards for more installation guidelines.

## PARALLEL INSTALLATION

Ensure proper uniform current distribution with equal resistance cables on both sides of the Battery Terminals that are connected to common load/ charger bus bars. No center- tapping's are allowed as it would cause differential drain on batteries in the battery bank.

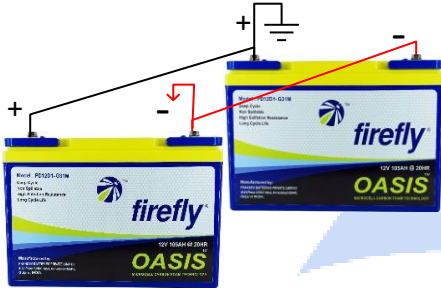

## SERIES INSTALLATION



## CONNECTING THE BATTERY

- Take care not to short circuit the terminals on the battery.
- Make sure the terminals and connectors are clean and free of corrosion.
- Connect the positive cable to the positive (+) battery terminal.
- Connect the negative cable to the negative (-) battery terminal.
- The terminals on the G31M are 3/8-16 UNC and should be torqued to 16 ft lbs (21.69 nm).

## OPERATION & CHARGING

- Firefly batteries can be operated in a partial state of charge for longer periods of time without sustaining any permanent damage.
- The batteries may emit gas during the first 10-20 charge cycles. This is normal. If liquid is observed leaking from the vent caps (the smaller grey caps on the top of the battery), wipe clean with rubbing alcohol and tighten the valve cap to 1-3Nm (0.75-2.2ft-lbs.) (1.01-2.98nm) If leaking persists, contact your dealer.
- **Max discharge Current:** The maximum recommended discharge current is 0.7C Amps for extended periods of time to ensure the longevity of the battery. The firefly battery can discharge up to 3C for short periods.
- **Max Charge Current:** The max recommended continuous charge rate is 0.5C but 1C can be tolerated for sporadic charge sessions. Frequently charging at 1C will negatively impact the battery's lifetime.
- **Peukerts Constant:** If you have hardware that requires a Peukerts constant to be entered, we recommend that you do not change the factory settings due to the large inaccuracies based on varying discharge rates. The Peukerts constant for the firefly battery for the 10hr and 20hr rate is 1.07. It is 1.12 for 6.5hr and 1.8hr rate. Keep in mind that whatever Peukerts correction you use, you will lose accuracy with extremely slow discharges.

**Firefly International Energy Co.**

Office : 155 L New Boston Street, Woburn, MA 01801, USA.

[WWW.FIREFLYENERGY.COM](http://WWW.FIREFLYENERGY.COM)

- **Temperature Compensation:** If you have hardware that allows the user to enter a temperature coefficient, use 24mV/C° for temperature compensation for a 12V battery & 48mV for a 24V battery. Contact us for higher voltages. The temperature compensation should be zero at an ambient temperature of 25°C/77°F. This means that for every degree the battery is ABOVE 25°C/77°F, the charge V should be reduced by 24mV/48mV. For every degree that the battery is BELOW 25°C/77°F, the charge voltage should be increased by 24mV/48mV. Note that with Firefly batteries, the battery temperature sensor only needs to be near the batteries to measure ambient temperature.
- **Charge V Settings:** Charge the G31M to 14.4V with temperature compensation (bulk phase) and continue charging until the charging current drops to 0.5A for the G31M. You DO NOT need to fully charge the batteries each cycle in order to maintain the capacity however see the section below on periodic fast & complete charge cycle recommendations.
- **Float-Charging:** For charging sources that may be charging the battery for an extended period of time (solar, or an alternator if motoring for a while); set the float voltage to 13.4V or 13.5V for the G31M. Firefly batteries do not require a float charge on a regular basis. However, if you are float charging, due to their longer projected lifespan, it is important to keep the float voltage at 13.4V or 13.5V to ensure the battery lasts for as many cycles as possible for shorter durations (6 to 8 hours).
- **Reset to bulk phase:** for programmable charging sources, adjust the “reset to bulk phase” to occur if the battery voltage drops below 12.0V for >1 minute for the G31M
- **Periodic Fast & Complete Charge Cycle Recommendations:** Note that periodic fast (high current) charging from a low state of charge can help restore usable capacity after periods of repeated slow charging (less than 0.2C) or deep discharge cycles. It is recommended that the battery goes through a complete charge cycle from a low state of charge every week if they are being heavily cycled or at minimum every 30 days. Ideally the batteries will be charged at a current of 0.4C (42 Amps for an Oasis G31M) but a minimum of 0.2C (21A per string of G31M battery) is acceptable. These charge cycles should end with a 24hour float charge at 13.5V for the G31. For applications lacking fast charging capability, you may use 0.1C Amps current limit (10.5 Amps for G31M).
- **Operating Temperature:** The optimum operating temperature for a lead-acid battery is 25°C (77°F). As a rule of thumb, every 8-10°C (14-18°F) rise in temperature will cut the battery life in half. Note that continuous duty at elevated temperature will shorten the life of any battery. At subzero ambient at CCCV charging, reduce the limit current to 0.1C Amps instead of 0.4C rate charging for prolonged duration.

## **RESTORATION CHARGE**

As stated, Firefly Batteries can operate in a partial state of charge for longer periods of time without sustaining any permanent damage. The usable capacity will decrease, however, with each cycle within a partial state of charge, up to a point. In order to regain the full original capacity and in some cases more, it is necessary to perform a restoration charge. To perform the restoration charge: charge the G31M to 14.4V and continue to charge until the current drops to 0.5 A on the G31 and apply a float charge of 13.5V for 6 to 8hours. Fully discharge the battery to 10.5V (G31M) then repeat the same charge cycle.

## **SAFETY**

**For any operation on the batteries, from storage to recycling, the following safety rules should be observed:**

- Do not smoke.
- Use tools with insulated handles to tighten connections.
- Check that the connections between the cells / mono blocs are fitted correctly.
- Never place tools on the batteries (metal tools are particularly dangerous).
- Never lift the cells / mono blocs at the terminals.
- Never use a synthetic cloth or sponge to clean the cells /mono blocs.
- Use water (wet cloth) without additives.
- Avoid shocks.
- Even when disconnected, a battery remains charged.
- Always wear insulating gloves and glasses while handling batteries.
- Read the “Installation Instruction” and “Operating Instruction” carefully.

## **EMERGENCY PROCEDURES**

**Battery Electrolyte Eye Contact:** Immediately remove any contact lenses if present. Flush eyes with water for at least 15 minutes. Seek medical attention immediately.

**Skin Contact:** Remove contaminated clothing. Flush with water for at least 15 minutes. Seek medical attention immediately.

**Inhalation:** Remove to fresh air. Seek medical attention immediately. PRECAUTIONS FOR SAFE

## **HANDLING AND USE**

Steps to be taken in case of a broken battery case or electrolyte leakage: neutralize spilled electrolyte and exposed battery parts with soda ash, sodium bicarbonate, lime, etc. Do not use organic or combustible material. Wear acid resistant clothing, boots, gloves, face shield, and proper respiratory protection.

**Waste Disposal Information:** Please observe all federal, local, and state regulations regarding the disposal of lead/acid batteries.

**Precautions to be taken in Handling, Storing, and Transportation:** Store in cool, dry area away from combustible materials; store in well-ventilated areas. Other Precautions: Do not charge in unventilated areas

## **SHIPPING, STORAGE AND DISPOSAL**

### **D.O.T. REGULATIONS-NONSPILLABLE**

Firefly Batteries Group 31M battery meets the non-spillable criteria. It is exempted from CFR 49, Subchapter C requirements, which translates to no proper shipping name, no hazardous class, no UN number, no packaging group and no hazardous labels when transporting, provided that the following criteria are met:

1. the batteries must be protected against short circuits and securely packaged.
2. The batteries and their outer packaging must be plainly and durable marked “NON- SPILLABLE” or “NON-SPILLABLE BATTERY”.

## **SHELF LIFE**

The maximum storage time at 20°C/68°F is 15 months. The maximum storage time at 30°C/86°F is 8 months. The maximum storage time at 40°C/104°F is 3 ~ 4 months.

Higher temperatures cause higher self-discharge and shorter storage time between recharging operations.

For extended storage periods it is recommended to check the „open circuit voltage in the following intervals:

**Storage at 20°C/68°F:** Check Open circuit voltage after a storage period of 12 months, then every 3 months afterwards.

**Storage at 30°C/86°F:** After a storage period of 6 months, then every 2 months afterwards.

**Storage at 40°C/104°F and above:** After a storage period of 3 months, then every 1 months afterwards.

## **FULLY-CHARGED WHEN SHIPPED**

The Oasis will be shipped from the factory fully charged. Some venting from the valves is possible when it arrives.

STORAGE CONDITIONS - **In the user's interest the storage period should be as short as possible.**

- The temperature has an impact on the self-discharge rate and hence, it is important to store the batteries in a fully charge condition in a cool but frost-free room.
- The preferred storage temperature range is + 5°C/41°F to 20°C/68°F if storage room can be conditioned. If stored sub-zero, it must be stored in a charged/above semi-charged state.
- Storage on a pallet wrapped in plastic material is authorized. It is not recommended however in rooms where the temperature fluctuates significantly, or if high relative humidity can cause condensation under the plastic cover.
- With time, this condensation can cause a whitish hydration on the poles and lead to high self-discharge by leakage current. This hydration has no effect on the battery operation or service life if no corrosion occurs. It is forbidden to stack one pallet above the other.
- Avoid storing unpacked cells / mono blocs on sharp-edged supports. It is recommended to have the same storage conditions within a batch, pallet or room.
- The storage location should provide the following functions:
  - Shelter the cells / mono blocs from harsh weather and risk of flooding.
  - Protect the batteries against any overheating risk induced by direct exposure to the sun radiation or by their amplification through glass walls.
  - Protect the batteries from any risk of electric shock resulting from short circuiting by a conductive object or from a building up of conductive dust.
  - Avoid any risk of mechanical shock caused by dropping objects onto the cell / mono bloc or by dropping the cell / mono bloc itself.

## **RECYCLING**

There is an existing infrastructure to recycle lead acid batteries. Because Firefly's technology uses carbon, it actually decreases the amount of lead in the battery. Firefly's microcell technology can be recycled through the existing lead acid infrastructure.

**Firefly International Energy Co.**

Office : 155 L New Boston Street, Woburn, MA 01801, USA.

[WWW.FIREFLYENERGY.COM](http://WWW.FIREFLYENERGY.COM)